


# Hygienic Sample Coolers

BULITIN DATE 10.22.04

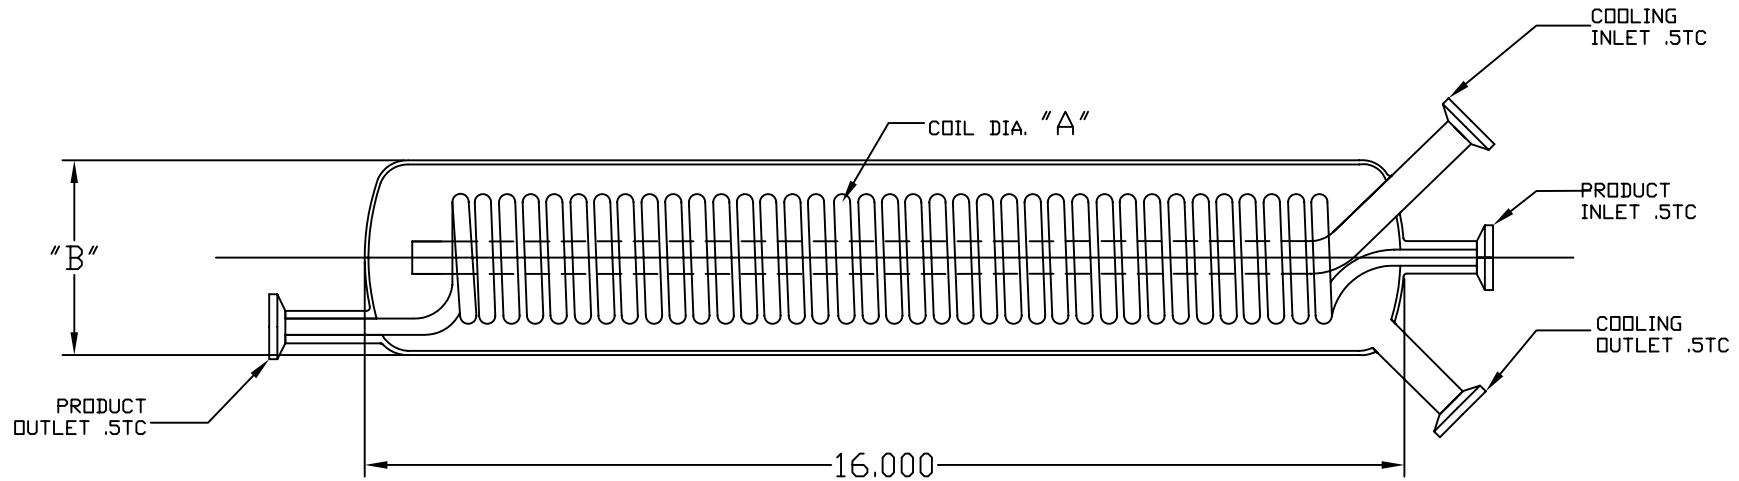

"A"	20RaID 20RaOD	15RaEPID 20RaOD	"B"
1/4"	5GG451BADD	5GG451BAMD	3.0
3/8"	5GG571BADD	5GG571BAMD	4.0

## Options:

- \* Coolant inlet and outlet control valves (typically ball valves)
- \* Product inlet control valves (typically diaphragm valve)
- \* Product outlet control valves (typically bleed valve)
- \* FNPT's, MNPT's and larger triclamp connections are available for all inlet and outlet connections.
- \* Other finishes available.
- \* Other materials of construction available.